



BRICKPAVED CROSSING
SCALE 1:50

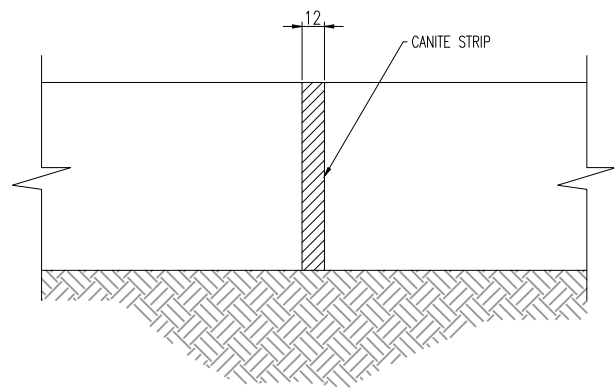

CANITE STRIP DETAIL
SCALE 1:2

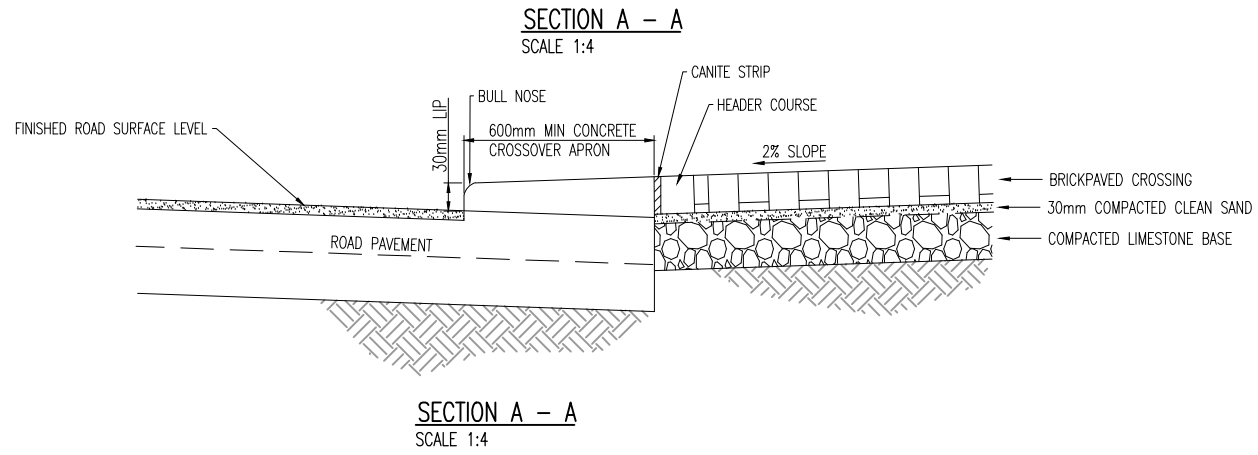

NOTES:

- VEHICLE CROSSING OBSTRUCTIONS: SHOULD AND TREE, POLE, PIT, MANHOLE, GULLY, SIGN OR ANY OTHER OBSTRUCTION BE LOCATED ON THE PROPOSED ALIGNMENT OF THE VEHICLE CROSSING, THE APPLICANT SHALL BE RESPONSIBLE FOR THE COSTS ASSOCIATED WITH REMOVAL OR ALTERATIONS OF SAME (IF APPROVED BY THE CITY OF JOONDALUP).
- PROPERTY LINE LEVELS: THE GRADIENT ON VERGES SHALL BE +2% TO THE PROPERTY LINE, A NEGATIVE SLOPE IS NOT ALLOWED.
- 12mm CANITE STRIP: SHALL BE CANITE MATERIAL AT LEAST 100mm DEEP. TYPE OF CANITE AS PER WRITTEN SPECIFICATION.
- MAXIMUM SPACING BETWEEN CONTROL JOINTS TO BE 1500mm.
- VEHICLE CROSSINGS TO BE CONSTRUCTED AT 90 DEGREES TO THE KERB OR AS DIRECTED BY THE CITY OF JOONDALUP.
- RESIDENTIAL AND RURAL CROSSINGS TO BE MINIMUM OF 3m AND MAXIMUM 6m WIDE AT LOT BOUNDARY.
- RESIDENTIAL AND RURAL CROSSINGS SPLAYS TO BE 1000mm WIDE.
- WHEN CROSSING IS 6m WIDE AT LOT BOUNDARY, SPLAYS AT KERB LINE ARE OPTIONAL.
- RESIDENTIAL CROSSINGS SHALL BE MINIMUM 100mm THICK, 25MPa @ 28 DAYS COMPRESSION STRENGTH.
- RESIDENTIAL CROSSINGS SHALL HAVE A 30mm LIP MAXIMUM ABOVE THE FINISHED ROAD SURFACE LEVEL.
- TRANSITION FROM BARRIER/SEMI-MOUNTABLE KERB TO FLUSH ROAD SURFACE LEVEL TO BE A MINIMUM 700mm BEYOND BOTH SIDES OF THE WINGS OF THE CROSSING.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE CROSSOVER GUIDELINES.

SCHEDULE OF REQUIREMENTS

- PAVER - MINIMUM 60mm HEAVY DUTY
- BRICKPAVING PATTERN - REFER TO DRG No. ES 07-08
- SEND BED - 20-40mm THICK
- SUB-BASE - 100mm CRUSHED LIMESTONE OR ROCKBASE
- EDGE RESTRAINTS - AS SHOWN ON DRAWING

No.	REVISION	BY	DATE	CHK.	AUTH.	SURVEY INFORMATION	DATUM	GRID	SCALE	DESIGNED	APPROVED	LOCALITY
0	ISSUED	C.P.L	09/1999						AS SHOWN	CITY OF JOONDALUP 1999		
1	AMENDED AFTER REVIEW	S.A.T	02/2001							CITY OF JOONDALUP 1999	R.MARCH 20/10/2017 MANAGER INFRASTRUCTURE MANAGEMENT SERVICES	
2	AMENDED TO LATEST STANDARDS	R.L	08/2015			DESIGN DIRECTORY: Ims on 'flamenco'// I/CDS/DRAWING STANDARDS/STANDARD DRAWINGS	HORIZONTAL					
3	MINIMUM 600mm CONCRETE APRON ADDED TO DETAIL	C.L	05/2016					AS SHOWN				
4	SPLAY WIDTH CHANGED TO 1000 WIDE, PREVIOUS NOTES 11-14 (COMMERCIAL RELATED) REMOVED	S.Z	10/2017			DRAWING DIRECTORY: Ims on 'flamenco'// I/CDS/DRAWING STANDARDS/STANDARD DRAWINGS	VERTICAL					
						CD ROM ARCHIVE No. N/A		AS SHOWN				
<p>CROSSOVERS AND VERGE RESIDENTIAL BRICK PAVED CROSSOVERS</p>											<p>CITY OF JOONDALUP</p> <p>DRAWING No. ES 07-04 SHEET No. A1</p>	